

Fire tests on building materials and structures —

Part 3: Classification and method of test for external fire exposure to roofs

ICS 13.220.50

Committees responsible for this British Standard

The preparation of this British Standard was entrusted by Technical Committee FSH/22, Fire resistance tests, to Subcommittee FSH/22/8, Test procedures for external fire exposure to roofs, upon which the following bodies were represented:

Association of British Roofing Felt Manufacturers
 BRE — Building Research Establishment
 BRE/LPC Laboratories
 British Rigid Urethane Foam Manufacturers' Association
 Concrete Tile Manufacturers Association
 Eurisol (UK Mineral Wool Association)
 Fibre Cement Manufacturers Association Ltd.
 Flat Glass Manufacturers' Association
 Flat Roofing Alliance
 Gypsum Products Development Association
 Home Office
 Mastic Asphalt Council Ltd.
 National Association of Rooflight Manufacturers
 National Federation of Roofing Contractors
 National GRP Construction and Engineering Federation
 OPDM — Building Division
 UK Steel Association
 Warrington Fire Research Centre

This British Standard was published under the authority of the Standards Policy and Strategy Committee on 14 June 2004

© BSI 14 June 2004

First published June 1958
 Second edition November 1975
 Third edition June 2004

Amendments issued since publication

Amd. No.	Date	Comments

The following BSI references relate to the work on this British Standard:
 Committee reference FSH/22/8
 Draft for comment 03/109613

Contents

	Page
Committees responsible	Inside front cover
Foreword	ii
<hr/>	
1 Scope	1
2 Normative references	1
3 Terms and definitions	1
4 Classification	1
5 Three stage test method incorporating burning brands, wind and supplementary radiant heat	2
<hr/>	
Annex A (informative) Apparatus for roof test	6
Annex B (informative) Intensity of radiated heat on specimen	10
<hr/>	
Figure A.1 — Typical roof test apparatus	6
Figure A.2 — Instrument locations for the calibration element	7
Figure A.3 — Specimen holder	8
<hr/>	
Table B.1 — Intensity of radiated heat	10
<hr/>	

Foreword

This Part of BS 476-3 has been prepared by Subcommittee FSH/22/8. It is based on BS 476-3:1958 and it supersedes BS 476-3:1975 which is withdrawn.

The tests described in this part of BS 476 are designed to give information concerning the hazard that exists of fires spreading to the roof of a building from a nearby fire outside the building itself. The tests are not concerned with the behaviour of a roof when subjected to the effects of fire on its underside.

A preliminary test is made in which a specimen section of the roof is subjected to the effects of flame in the absence of radiation. Unless the specimen is so affected by this test that it is obvious it would not pass the principal tests, i.e. the penetration and the spread of flame tests, these are then carried out using the radiated heat apparatus.

When subjected to the penetration test, specimens are exposed to radiation of intensity 12 kW/m^2 measured on the surface of the specimen. This can be regarded as, for example, the intensity incident on a roof 7.6 m above ground level from a fire 13.7 m away in a building with a facade of $15.2 \text{ m} \times 15.2 \text{ m}$ and 50 % window openings. Because wind will tend to carry any surface flames through any fissures in a roof, provision is made in the test to simulate the effect of a wind of 6.7 m/s (15 miles per hour) by applying suction to the lower side of the roof specimen during the test.

In the spread of flame test, however, the intensity of radiation varies over the exposed surface of the specimen. The distance to which the fire spreads downwards over the specimen thus gives a measure of the minimum intensity required to ignite the surface when a small ignition source such as a brand is present.

NOTE This intensity can be interpreted as being equivalent to the distances given in Table B.1, between an exposed roof 7.6 m above ground level and a burning building with a facade $15.2 \text{ m} \times 15.2 \text{ m}$ and 50 % window openings.

This British Standard calls for the use of substances and/or procedures that may be injurious to health if adequate precautions are not taken. It refers only to technical suitability and does not absolve the user from legal obligations relating to health and safety at any stage.

This publication does not purport to include all the necessary provisions of a contract. Users are responsible for its correct application.

Compliance with a British Standard does not of itself confer immunity from legal obligations.

Summary of pages

This document comprises a front cover, an inside front cover, pages i and ii, pages 1 to 11 and a back cover.

The BSI copyright notice displayed in this document indicates when the document was last issued.

1 Scope

The tests given in this British Standard are designed to enable measurement of:

- a) capacity of a representative section of a roof to resist penetration by fire when the external surface is exposed to radiation and flame; and
- b) distance of the spread of flame on the outer surface of the roof covering under certain conditions.

Roofs are graded according to the angle at which they are tested, the time for which they resist penetration by fire, and the distance of superficial spread of flame on their external surface.

2 Normative references

The following referenced documents are indispensable for the application of this document. For dated references, only the reference cited applies. For undated references, the latest edition of the referenced document (including any amendments).

BS EN 13238, *Reaction to fire tests for building products — Conditioning procedures and general rules for selection of substrates*.

BS EN 13501-1, *Fire classification of construction products and building elements — Part 1: Classification using test data from reaction to fire tests*.

3 Terms and definitions

For the purpose of this British Standard, the following terms and definitions apply.

3.1

penetration by fire

appearance of glowing or flaming on the underside of the specimen other than that of the test flame

NOTE In the text, this term has been shortened to “penetration”.

3.2

non-combustible

product which is reaction to fire Euroclass A1, as described in BS EN 13501-1

4 Classification

4.1 Roof system

Roof systems shall be designated by the letters EXT. F. or EXT. S. to indicate whether the test results apply to a flat (horizontal) or an inclined roof system, respectively.

4.2 Fire resistance of roof system

4.2.1 Coding system

Roof systems subject to conditions of external fire shall be classified according to both the time of penetration and the distance of spread of flame along their external surface.

Each category designation shall consist of two letters, e.g. AA, AC, BB, these being determined as specified in 4.2.2 and 4.2.3.

4.2.2 Fire penetration (first letter)

- A. Those specimens that have not been penetrated within one hour.
- B. Those specimens that are penetrated in not less than 30 min.
- C. Those specimens that are penetrated in less than 30 min.
- D. Those specimens that are penetrated in the preliminary flame test.

4.2.3 Spread of flame (second letter)

- A. Those specimens on which there is no spread of flame.
- B. Those specimens on which there is not more than 533 mm spread of flame.
- C. Those specimens on which there is more than 533 mm spread of flame.
- D. Those specimens that continue to burn for five minutes after the withdrawal of the test flame or spread more than 381 mm across the region of burning in the preliminary test.

4.2.4 Suffix "X"

Attention shall be drawn to dripping from the underside of the specimen, any mechanical failure, and any development of holes, by adding a suffix "X" to the designation to denote that one or more of these took place during the test.

EXAMPLE 1 EXT. F. AA is a flat roofing system with one hour fire penetration resistance on which there was no spread of flame.

EXAMPLE 2 EXT. S. CCX is an inclined roofing system with less than 30 min fire penetration resistance, on which the spread of flame exceeded 533 mm and further deterioration took place.

5 Three stage test method incorporating burning brands, wind and supplementary radiant heat

5.1 Apparatus

5.1.1 Brands, comprising a simulated town gas flame (55.2 % hydrogen, 27.4 % natural gas, 17.4 % nitrogen), (230 ± 10) mm long from a (9.5 ± 0.1) mm diameter orifice that shall be set prior to application on the test specimen.

5.1.2 Wind. Provision shall be made in the test to simulate the effect of a wind speed of 6.7 m/s, generated by applying suction to the lower side of the roof specimen. Apparatus shall be provided, capable of reducing the pressure on the underside of the specimen by (1.5 ± 0.1) mm of water below that on the upper side, for the duration of the test. The suction under the specimen shall be measured. An inclined tube manometer may be used for this purpose.

5.1.3 Radiant panel, (915 ± 5) mm square. It shall be provided capable of being supported either at an angle of 45° or horizontal according to the test required, and shall comprise four (300 ± 5) mm square surface combustion panels with their centres arranged at the corners of a square of (480 ± 5) mm side (see Figure A.1).

The radiation intensity incident on the specimen shall be established with the radiant panel in the test position and the calibration element set at a perpendicular distance of (585 ± 5) mm from the radiant panels. The radiant panels shall be capable of providing a total heat flux distribution on the surface of the calibration element such that the heat flux at the four major axes, as shown in Figure A.2, is (12 ± 1.5) kW/m², when all four radiant panels are used for the penetration test (stage 3, see 5.7.3).

When required for the spread of flame test (stage 2, see 5.7.2) the heat flux distribution on the surface of the calibration element shall be such that the heat flux at the four major axes, as shown in Figure A.2, is as follows:

- a) locations 1 and 2: (8.5 ± 1.0) kW/m²;
- b) locations 3 and 4: (3.5 ± 1.0) kW/m².

A 25 mm diameter Schmit Boelter heat flux meter, with a design range of (0 – 50) kW/m² shall be used to establish the heat flux distribution on the surface of the calibration element. The target receiving radiation from the radiant panels shall be flat, circular and coated with a durable matt black finish. The target shall be water cooled. Radiation shall not pass through any window before reaching the target. The instrument shall be robust, simple to set up and use, and stable in calibration. The instrument shall have an accuracy of within ±3 % and a repeatability within 0.5 %.

The calibration of the heat flux meter shall be checked by comparison with two instruments of the same type as the working heat flux meter and of similar range, held as reference standards and not used for any other purpose. One of the reference standards shall be fully calibrated at a competent laboratory at yearly intervals.

5.1.4 Calibration element, consisting of a smooth, flat (20 ± 2) mm thick board of calcium silicate material having the dimensions (840 ± 10) mm square and a density of (870 ± 100) kg/m³.

5.1.5 Timing device, with an accuracy of ± 5 s over 24 h.

5.1.6 Specimen holder. A metal specimen cover with a mica observation window is fixed to the framing (Figure A.1 and Figure A.3) and a non-combustible material is laid around the sides of the specimen frame to provide an air seal when the specimen is placed in position. Any small holes around the edges of specimen and its frame shall be sealed with mortar (3:1 sand:cement mix).

5.2 Calibration

Each time the radiant panel is ignited, achieve stable conditions and adjust the radiant panel to obtain a total heat flux distribution on the surface of the calibration element as specified in 5.1.3. The minimum period of time of stabilization for calibration of the radiant panel shall be 60 min.

5.3 Test conditions

Mount the test specimens at an angle of 45° in all tests except where test specimens represent flat roofs; in this case, test the specimens horizontally.

5.4 Test specimen

5.4.1 Number of test specimens

5.4.1.1 Preliminary ignition test with burning brands (stage 1)

One specimen shall be tested.

5.4.1.2 Spread of flame test with burning brands and supplementary radiant heat (stage 2)

Three specimens shall be tested.

5.4.1.3 Penetration test with burning brands, wind and supplementary radiant heat (stage 3)

Three specimens shall be tested.

5.4.2 Construction of specimens

Apply each test to a specimen of the roof structure (840 ± 10) mm square. The specimens shall be representative of the complete "end use" roof construction including at least one specimen of any joints used in each of the materials to be tested.

Where necessary the specimen shall be made rigid by providing a frame at the boundaries of the specimen constructed from non-combustible materials. Any gaps between the specimen and the frame shall be sealed with mortar (3:1 sand:cement mix) to provide an air seal. The specimen and its frame shall also form an air seal with the specimen cover of the test apparatus. See Figure A.1 and Figure A.3.

5.5 Conditioning

Condition the specimens in accordance with BS EN 13238. Erect and test them as soon as possible after leaving the conditioning atmosphere. The time between leaving the conditioning atmosphere and testing shall not exceed four hours.

5.6 Test environment

Carry out the testing in a draught-free area. The temperature in the enclosure shall be (20 ± 10) °C prior to the fire test. If any measures are taken to remove products of combustion from the test laboratory, they shall be in operation during the calibration period and maintained during the test.

5.7 Test procedure

5.7.1 Preliminary ignition test with burning brands (stage 1)

Apply the test brand (see 5.1.1) for 60 s at the centre of the upper surface of the specimen and direct it up the slope with the nozzle resting on the centre of the specimen and inclined at an angle of nominally 5° to it. For specimens which are tested horizontally, the direction of the flame shall correspond to that used for a sloping roof as indicated by the arrow in Figure A.1. For the purposes of this stage, mount the specimen in the specimen holder but do not expose it to any radiant heat.

5.7.2 Spread of flame test with burning brands and supplementary radiant heat (stage 2)

Bring the specimen, after mounting for test, in not longer than five seconds, from a position at room temperature to a position where its upper surface is exposed to radiated heat (see 5.1.3). Immediately the specimen is exposed to radiated heat, apply the burning brand (see 5.1.1) to the specimen for three minutes. The orifice of the brand shall be on the upper edge of the specimen (115 ± 5) mm from the centre line and the flame directed along the edge, the angle between the nozzle and the specimen being nominally 5° . For specimens tested flat, position the "upper" edge "A" as shown in Figure A.1.

5.7.3 Penetration test with burning brands, wind and supplementary radiant heat (stage 3)

Bring the specimen, after mounting for test, in not longer than five seconds, from a position at room temperature to a position where its upper surface is exposed to radiated heat (see 5.1.3). Immediately the specimen is exposed to the radiated heat, reduce the pressure on the underside as detailed in 5.1.2.

At five minutes from the start of the test, apply the burning brand in the direction shown by the arrow in Figure A.1 for 60 s, moving once up and once down the centre of the specimen at a rate of 0.3 m/10 s.

5.7.4 End of test

Terminate the test and extinguish the fire if there is a risk to the safety of personnel or impending damage to equipment, or if any of the following occur.

- a) Preliminary ignition test with burning brands (stage 1):
 - at one minute, in the event of no ignition of the specimen. If ignition occurs, once all flaming on the specimen has ceased.
- b) Spread of flame test with burning brands and supplementary radiant heat (stage 2):
 - at three minutes, in the event of no ignition of the specimen. If ignition occurs, once all flaming on the specimen has ceased.
- c) Penetration test with burning brands, wind and supplementary radiant heat (stage 3):
 - at one hour, in the event that no penetration occurs, or earlier if penetration occurs as defined in 3.1.

5.8 Observations and measurements**5.8.1 General**

During the test, the parameters given in 5.8.2, 5.8.3 and 5.8.4 shall be observed, measured and recorded. Dimensions shall be expressed in millimetres.

Progress of all flaming, regardless of duration, shall be estimated with respect to the base of the flame, in contact with the exposed surface, and not with respect to the flame envelope.

5.8.2 Preliminary ignition test with burning brands (stage 1)

- Duration of flaming, if this has occurred and exceeds five minutes.
- Extent of flame spread in any direction and whether the maximum distance in any direction exceeds 381 mm.
- The time and nature of penetration as defined in 3.1, if this has occurred.

5.8.3 Spread of flame test with burning brands and supplementary radiant heat (stage 2)

- The maximum distance of spread of flame down each specimen. Measurements shall be continued until flames have ceased.
- The average of the maximum spread of flame on each of the three specimens shall be used for determining the classification.
- Any marked variability between the three specimens.

5.8.4 Penetration test with burning brands, wind and supplementary radiant heat (stage 3)

- The time at which any penetration, as defined in 3.1, occurs.
- If failure of all specimens occurs within one hour, the average time for fire to penetrate the three specimens shall be used in determining the classification. If one or two of the specimens have not failed at one hour, this time shall be used in computing the average time of penetration.
- Any marked variability between the three specimens.
- Occurrence of melting of the test specimens and the production of molten droplets or debris (flaming and/or non-flaming).
- Any mechanical failure, or the development of holes, without penetration by fire.

5.9 Test report

The test report shall provide all information relevant to the selected procedures, the products tested and the results obtained.


NOTE Photographs are strongly recommended to illustrate the test results.

The report shall include the following.

- a) Reference to this test method, i.e. BS 476-3:2004.
 - b) Name and address of the test laboratory and the date of the test.
 - c) Names of the sponsor, the product and the manufacturer of the specimen and its component parts, if known. If unknown, this shall be stated.
 - d) Full description of the product tested with, if applicable, a description of the test roof deck. This shall include, where applicable:
 - method of attaching the roof covering, e.g. nails, fixings, spacing, adhesives, etc.;
 - density or mass per unit area of materials;
 - moisture content of the materials used.
- Building material classes (e.g. with reference to standards). The nature and quantity of adhesives or their rate of application might also be necessary to define the product uniquely.
- e) For each tested specimen, information concerning:
 - the roof pitch;
 - room temperature at the beginning of the test, in degrees centigrade.
 - f) For each tested specimen, any observations and measurements recorded during the test as specified in 5.8.
 - g) The classification achieved by the product as detailed in Clause 4.

Annex A (informative) Apparatus for roof test

The apparatus is shown in Figure A.1.

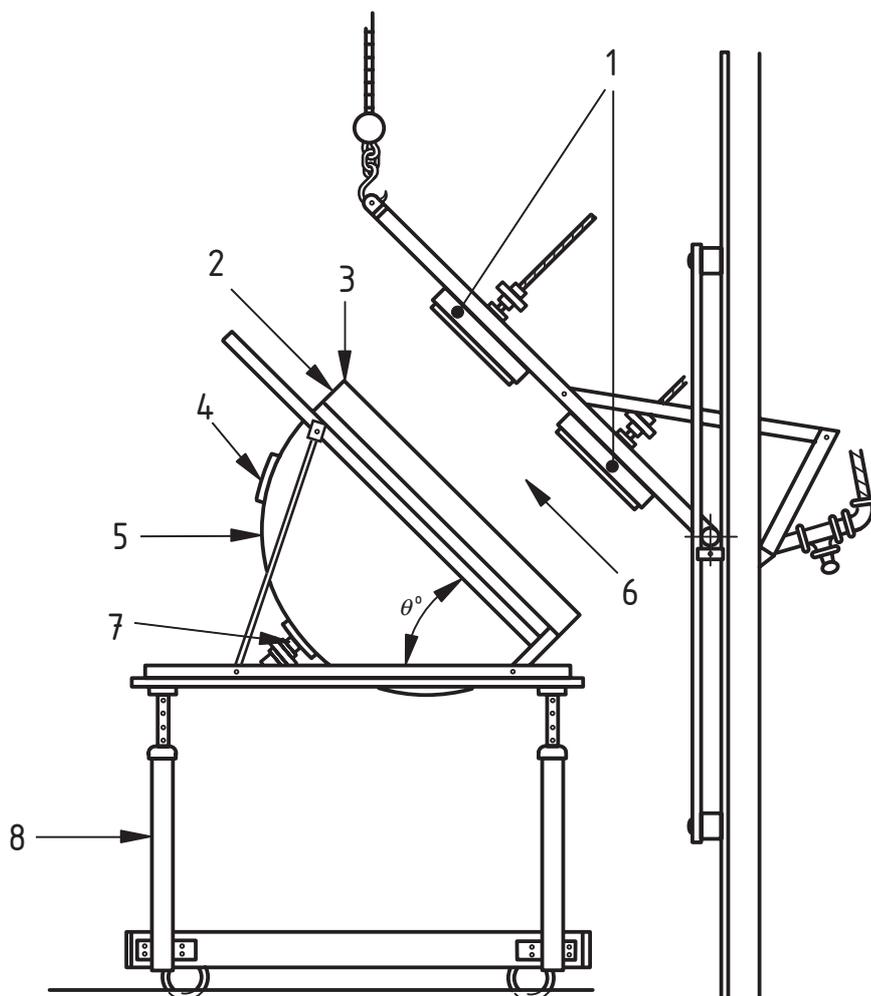

Key

- | | | | |
|---|----------------------------|---|--------------------|
| 1 | Surface combustion heaters | 5 | Specimen cover |
| 2 | Roof specimen | 6 | Direction of flame |
| 3 | Edge "A" | 7 | Suction pipe |
| 4 | Mica window | 8 | Trolley |

Angle $\theta = 45^\circ$ for inclined test

$\theta = 0^\circ$ for horizontal test

Figure A.1 — Typical roof test apparatus


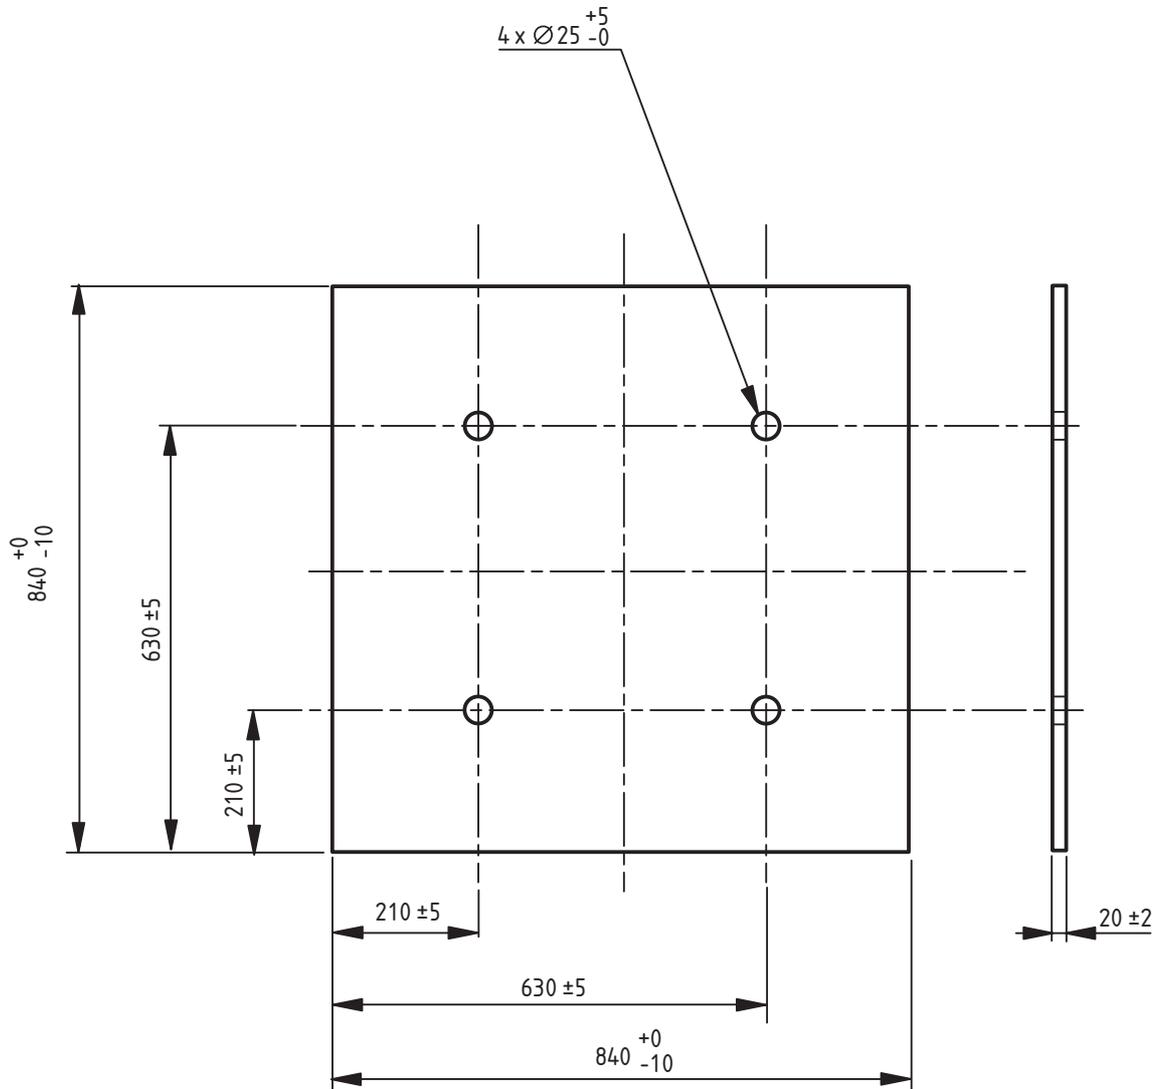



Figure A.2 — Instrument locations for the calibration element

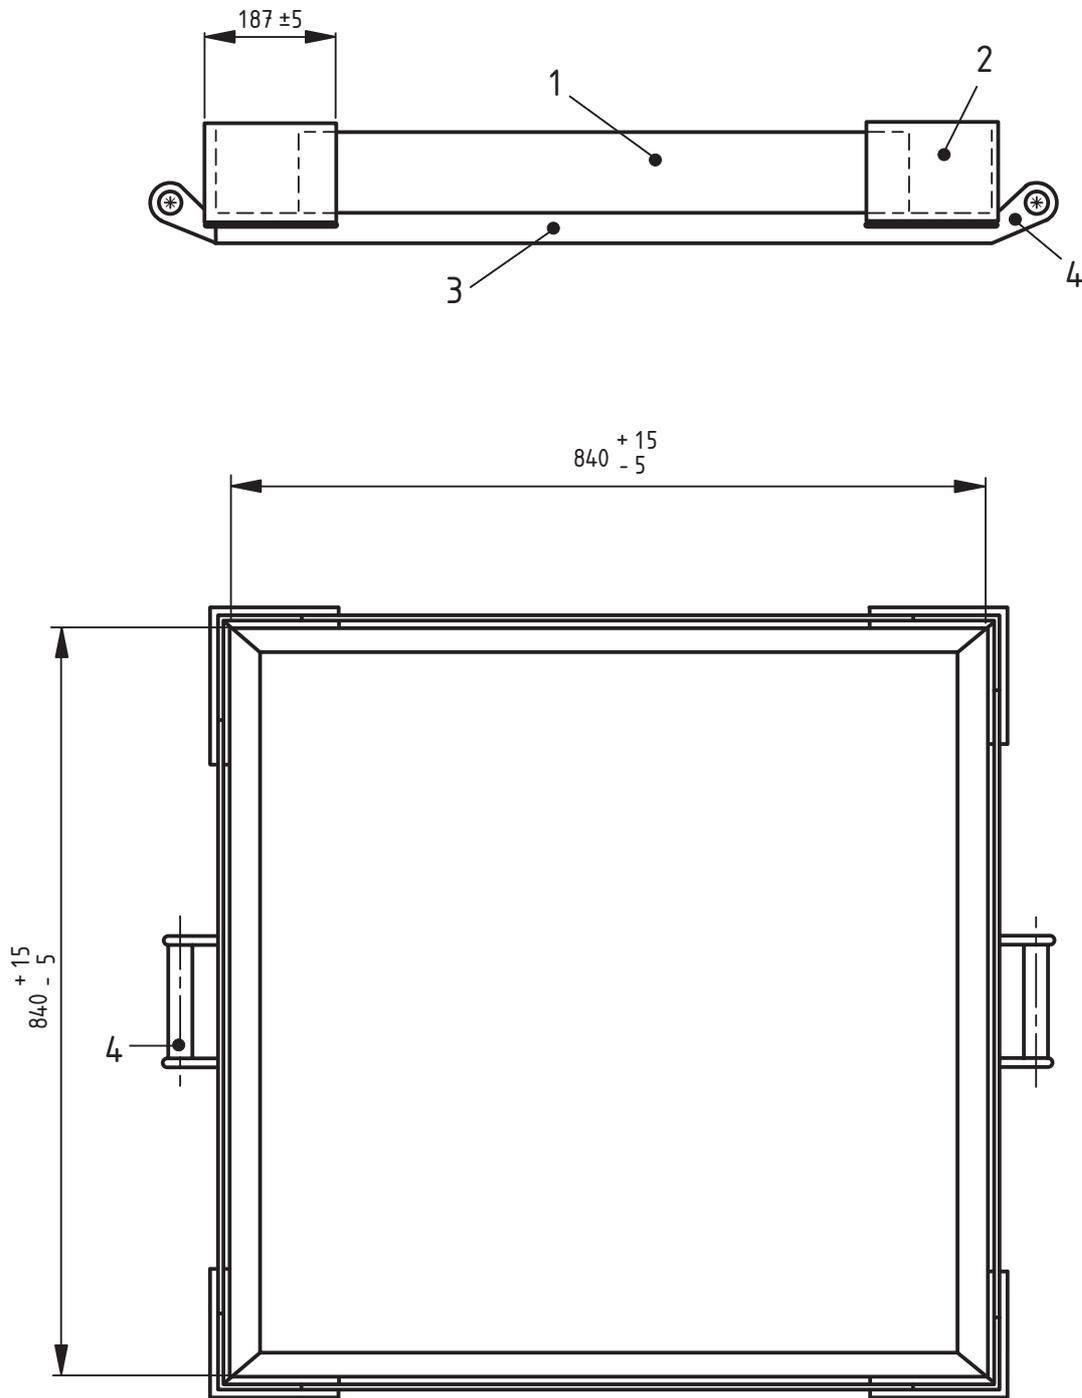

Key

- 1 Non-combustible board
- 2 Steel
- 3 Base frame
- 4 Handle

Figure A.3 — Specimen holder

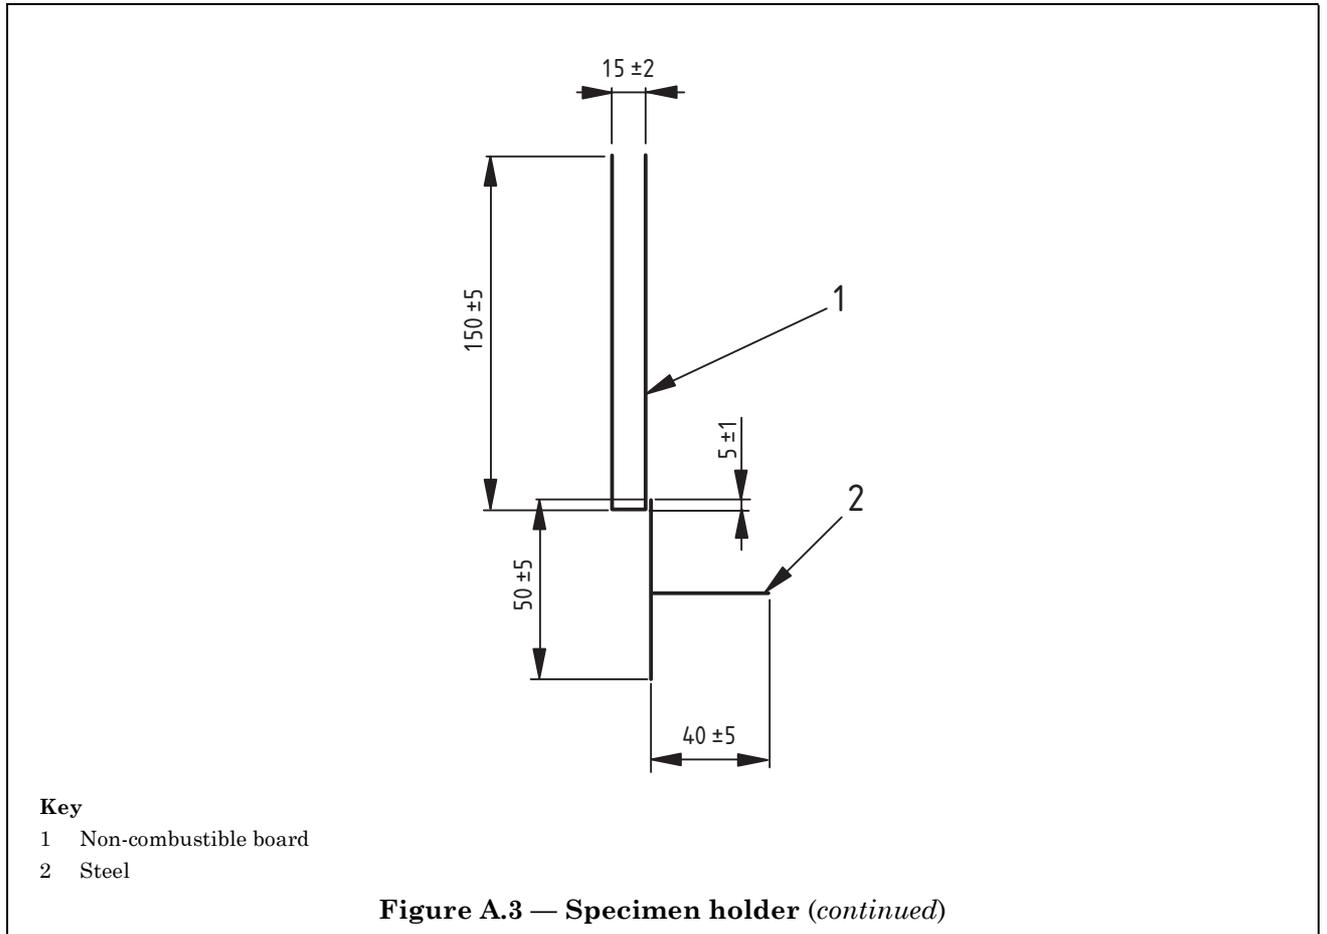

Annex B (informative)

Intensity of radiated heat on specimen

The intensity of radiated heat is shown in Table B.1.

Table B.1 — Intensity of radiated heat

Radiation intensity on specimen kW/m ²	Equivalent distance from a 15.2 m × 15.2 m facade with 50 % window openings to an adjacent roof m
7.95	21.3
9.21	18.3
9.21	18.3
7.95	21.3
5.86	24.4
4.19	27.4
2.51	36.6
2.51	36.6

BSI — British Standards Institution

BSI is the independent national body responsible for preparing British Standards. It presents the UK view on standards in Europe and at the international level. It is incorporated by Royal Charter.

Revisions

British Standards are updated by amendment or revision. Users of British Standards should make sure that they possess the latest amendments or editions.

It is the constant aim of BSI to improve the quality of our products and services. We would be grateful if anyone finding an inaccuracy or ambiguity while using this British Standard would inform the Secretary of the technical committee responsible, the identity of which can be found on the inside front cover. Tel: +44 (0)20 8996 9000. Fax: +44 (0)20 8996 7400.

BSI offers members an individual updating service called PLUS which ensures that subscribers automatically receive the latest editions of standards.

Buying standards

Orders for all BSI, international and foreign standards publications should be addressed to Customer Services. Tel: +44 (0)20 8996 9001. Fax: +44 (0)20 8996 7001. Email: orders@bsi-global.com. Standards are also available from the BSI website at <http://www.bsi-global.com>.

In response to orders for international standards, it is BSI policy to supply the BSI implementation of those that have been published as British Standards, unless otherwise requested.

Information on standards

BSI provides a wide range of information on national, European and international standards through its Library and its Technical Help to Exporters Service. Various BSI electronic information services are also available which give details on all its products and services. Contact the Information Centre. Tel: +44 (0)20 8996 7111. Fax: +44 (0)20 8996 7048. Email: info@bsi-global.com.

Subscribing members of BSI are kept up to date with standards developments and receive substantial discounts on the purchase price of standards. For details of these and other benefits contact Membership Administration. Tel: +44 (0)20 8996 7002. Fax: +44 (0)20 8996 7001. Email: membership@bsi-global.com.

Information regarding online access to British Standards via British Standards Online can be found at <http://www.bsi-global.com/bsonline>.

Further information about BSI is available on the BSI website at <http://www.bsi-global.com>.

Copyright

Copyright subsists in all BSI publications. BSI also holds the copyright, in the UK, of the publications of the international standardization bodies. Except as permitted under the Copyright, Designs and Patents Act 1988 no extract may be reproduced, stored in a retrieval system or transmitted in any form or by any means – electronic, photocopying, recording or otherwise – without prior written permission from BSI.

This does not preclude the free use, in the course of implementing the standard, of necessary details such as symbols, and size, type or grade designations. If these details are to be used for any other purpose than implementation then the prior written permission of BSI must be obtained.

Details and advice can be obtained from the Copyright & Licensing Manager. Tel: +44 (0)20 8996 7070. Fax: +44 (0)20 8996 7553. Email: copyright@bsi-global.com.